



# X-BLOCK & Y-BLOCK


For blowing cables in ducts with existing cables

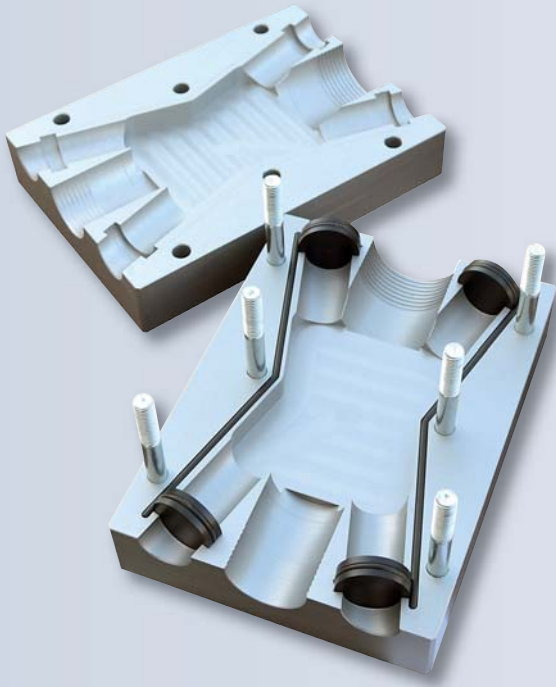

103-10352  
X-Block used to blow the second and third cable in a duct with one existing cable.

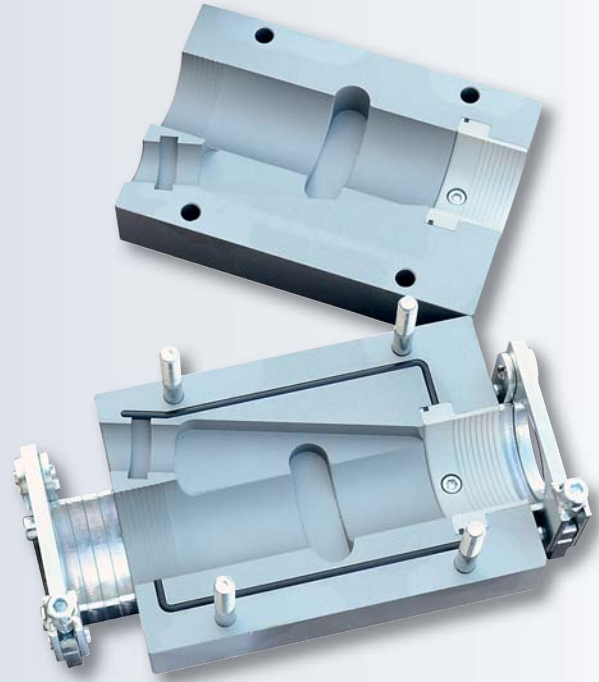

103-10378  
Y-Block used to blow the second cable in a duct with one existing cable.

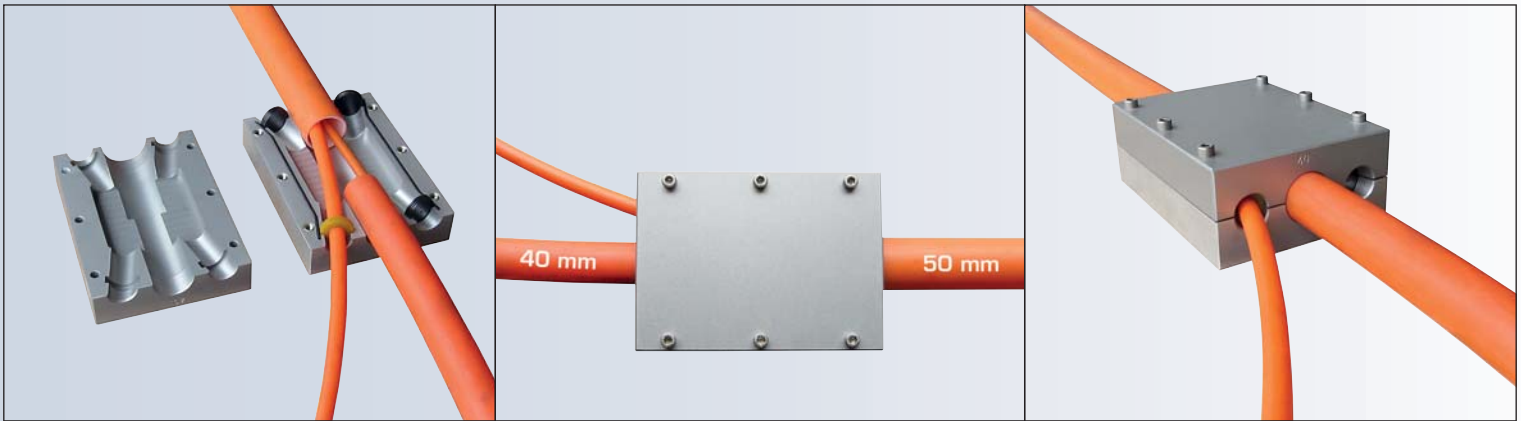

*For further information please contact:*